

NAMPA FIRE ACCESS & WATER SUPPLY PERMIT APPLICATION

Occupancy ID _____

APPLICANT (If not Owner) _____ PHONE _____

SITE ADDRESS _____ CITY _____ ZIP _____

OWNER _____ PHONE _____

MAILING ADDRESS _____ CITY _____ ZIP _____

Home is located on 5+ acres=EXEMPT Home is located 10+ miles from a fire station=EXEMPT

FOR INFORMATION ON REQUIREMENTS FOR ACCESS AND WATER SUPPLY SEE REVERSE

ROAD:

A SITE PLAN IS REQUIRED FOR EACH PERMIT APPLICATION

Home is in a platted subdivision (provide plat plan):
Subdivision _____ Lot _____ Block _____

Show on your site plan how you will comply with the access requirements on the reverse side of this form. This section not required for homes in a platted subdivision.

Width _____ Turning Radius _____

Vertical Clearance _____ Grade _____

Turnaround YES NO Bridges YES NO

Surface _____

WATER SUPPLY:

Effective 6/1/2014 there is no longer a minimum water supply requirement for single family dwellings that do not exceed 7,000 square feet. If the residence exceeds 7,000 square feet the water will be supplied by:

Municipal Water System

Elevated Tank Pressure Tank

Private/ Community Well capable of providing required fire flow

OR:

An NFPA 13D Fire Sprinkler System will be installed in the residence

By signing this application the owner/applicant agrees to the statements made on this application.

OWNER/APPLICANT SIGNATURE: _____ DATE _____

OFFICE USE ONLY

Application: Approved as submitted

Application: Approved with the following conditions:

NAME/SIGNATURE: _____ DATE _____


Certificate of Occupancy APPROVED _____ DATE _____

Access Road Guidelines

Privately maintained Roadway Width, Surface and Turnaround Requirements:

- All access roads serving 1 or 2 dwellings shall have a minimum improved driving surface width of 12 feet.
- All access roads serving 3 or more dwellings shall have a minimum improved driving surface width of 20 feet.

- If the access road exceeds 150 feet in length then a turnaround is required to be placed within 150 feet of the dwellings. See turnaround examples below.
- A vertical clearance of 13 feet 6 inches is required over the width of the access road.
- Approved driving surface materials: crushed gravel, recycled asphalt, concrete and asphalt. Surface material minimum thickness of 2 inches placed over 6 inches minimum base of pit run or equivalent.

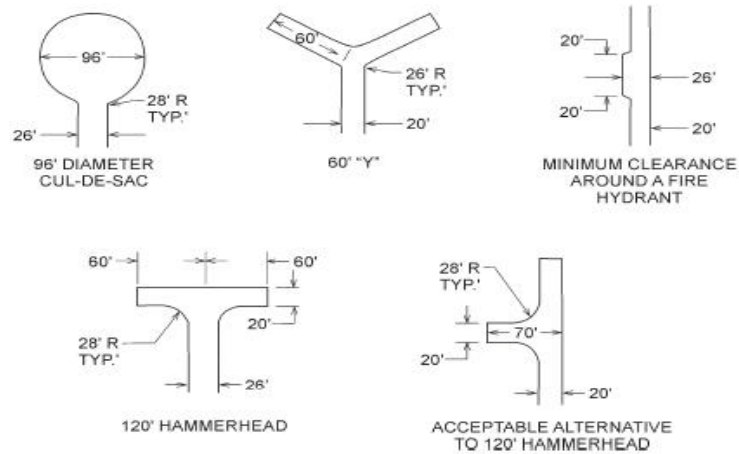

Water Supply for Fire Suppression

Dwellings over 7,000 SF (including attached garages, covered patios and porches) are required to have approved fire suppression water supply. The following are the only approved water supply options:

Municipal Water System- A fire hydrant, supplied by a municipal water system capable of the required fire flow. Fire Flow will meet or exceed $L \times W \times H$ of interior structure divide by 100 times 50%. i.e. a 70' by 100' residence with 9' ceilings would be $63,000/100 = 630 \text{ GPM} \times .50 = 325 \text{ GPM}$ fire flow for 2 hour period of time.

Private and/or Community Well- A fire hydrant, supplied by a private and/or community water system, located within 1,200 feet driving distance of the residence. The hydrant shall be capable of supplying the required fire flow for the structure. To be considered as a water supply the owner/applicant will be required to provide fire flow information from the water purveyor that verifies the well is capable of the required fire flow.

Elevated and Pressure Tanks- A fire hydrant, supplied by a tank with a water capacity of 180,000 gallons, located within 1,200 feet driving distance of the residence.

NFPA 13D Fire Sprinkler System- In lieu of the water systems above an NFPA 13D fire sprinkler system may be installed in the residence. Plans for the design of the fire sprinkler system are required to be submitted to the fire jurisdiction for review and approval. Installation inspections of the system will be carried out by the fire jurisdiction.

6/12/2014